




SITE SPECIFIC DATA				
Structure ID				B52
Treatment Flow Rate (gpm/cfs)				
Peak Flow Rate (cfs)				
Cartridge Quantity				8
Rim Elevation				
Pipe Data	Pipe Location	Pipe Size	Pipe Type	Invert Elevation
Inlet 1				
Inlet 2				
Outlet				
Notes: -				
PERFORMANCE SPECIFICATIONS				
Peak Treatment Capacities: ¹				
Max. Cartridge Quantity				8
NJDEP 80% Removal, 75 micron				
WA Ecology GULD - Basic & Phosphorus				
Max. Bypass Capacity				
1. Contact Austin Bluewater for alternative treatment and peak flow capacities.				

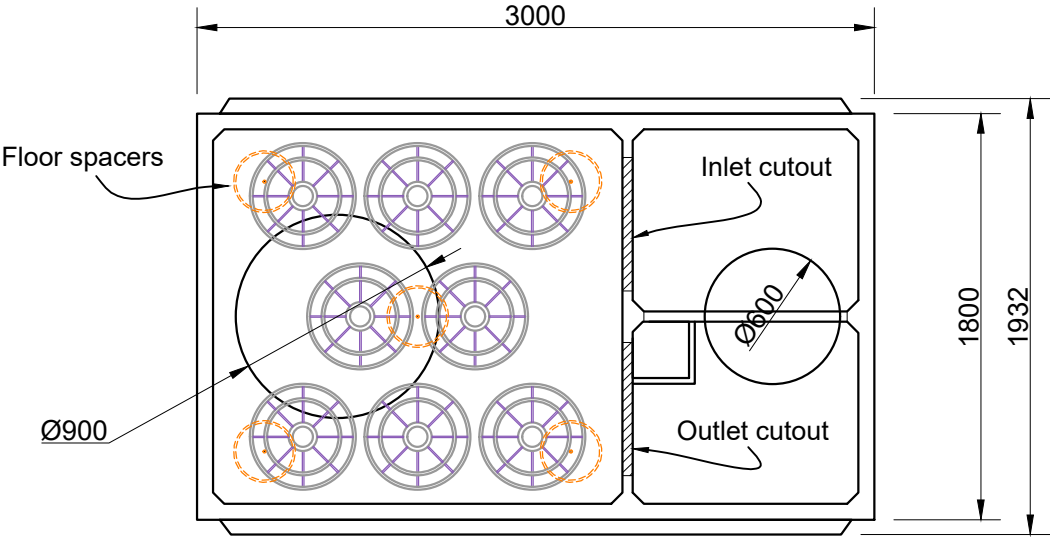

Plan View

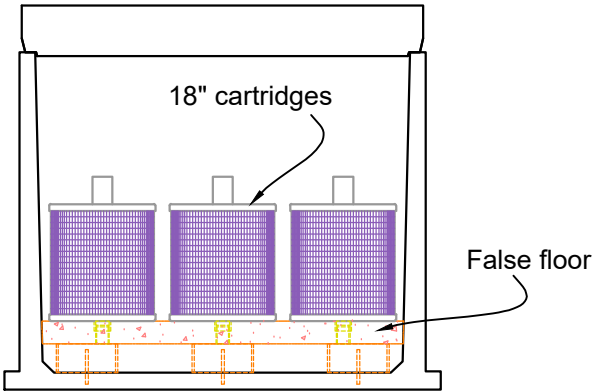

Cross Section

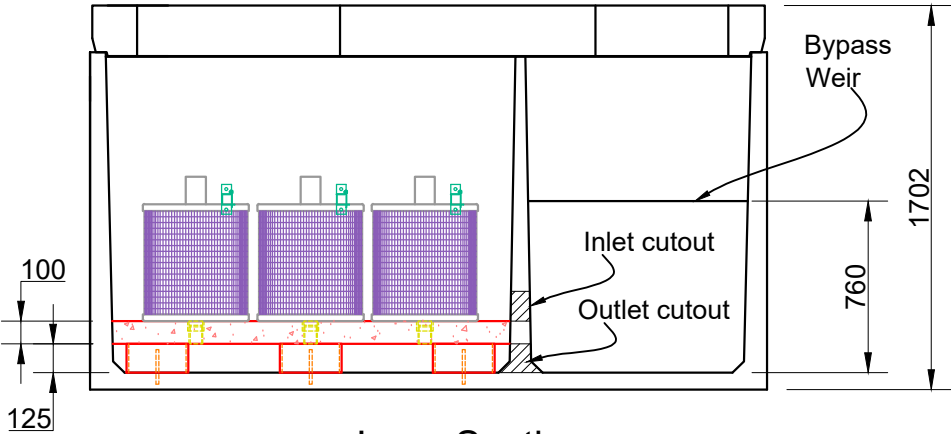

Long Section

Rev	Date	Comments
A	11/24	For Review



Christchurch Head Office
 20 Illinois Drive, Rolleston
 P O Box 16865, Hornby 8441,
 Christchurch
 0800 austin - 0800 287 846

Perkfilter Vault - 18" cartridges 1 - 8 Cartridges

THE COPYRIGHT OF THIS DRAWING REMAINS WITH AUSTIN BLUEWATER ENVIRONMENTAL CONCEPTS LTD.

Product code:	Scale: NTS
	Drawn: GN
	Date: 11/24
	Rev: A
PFV-18	